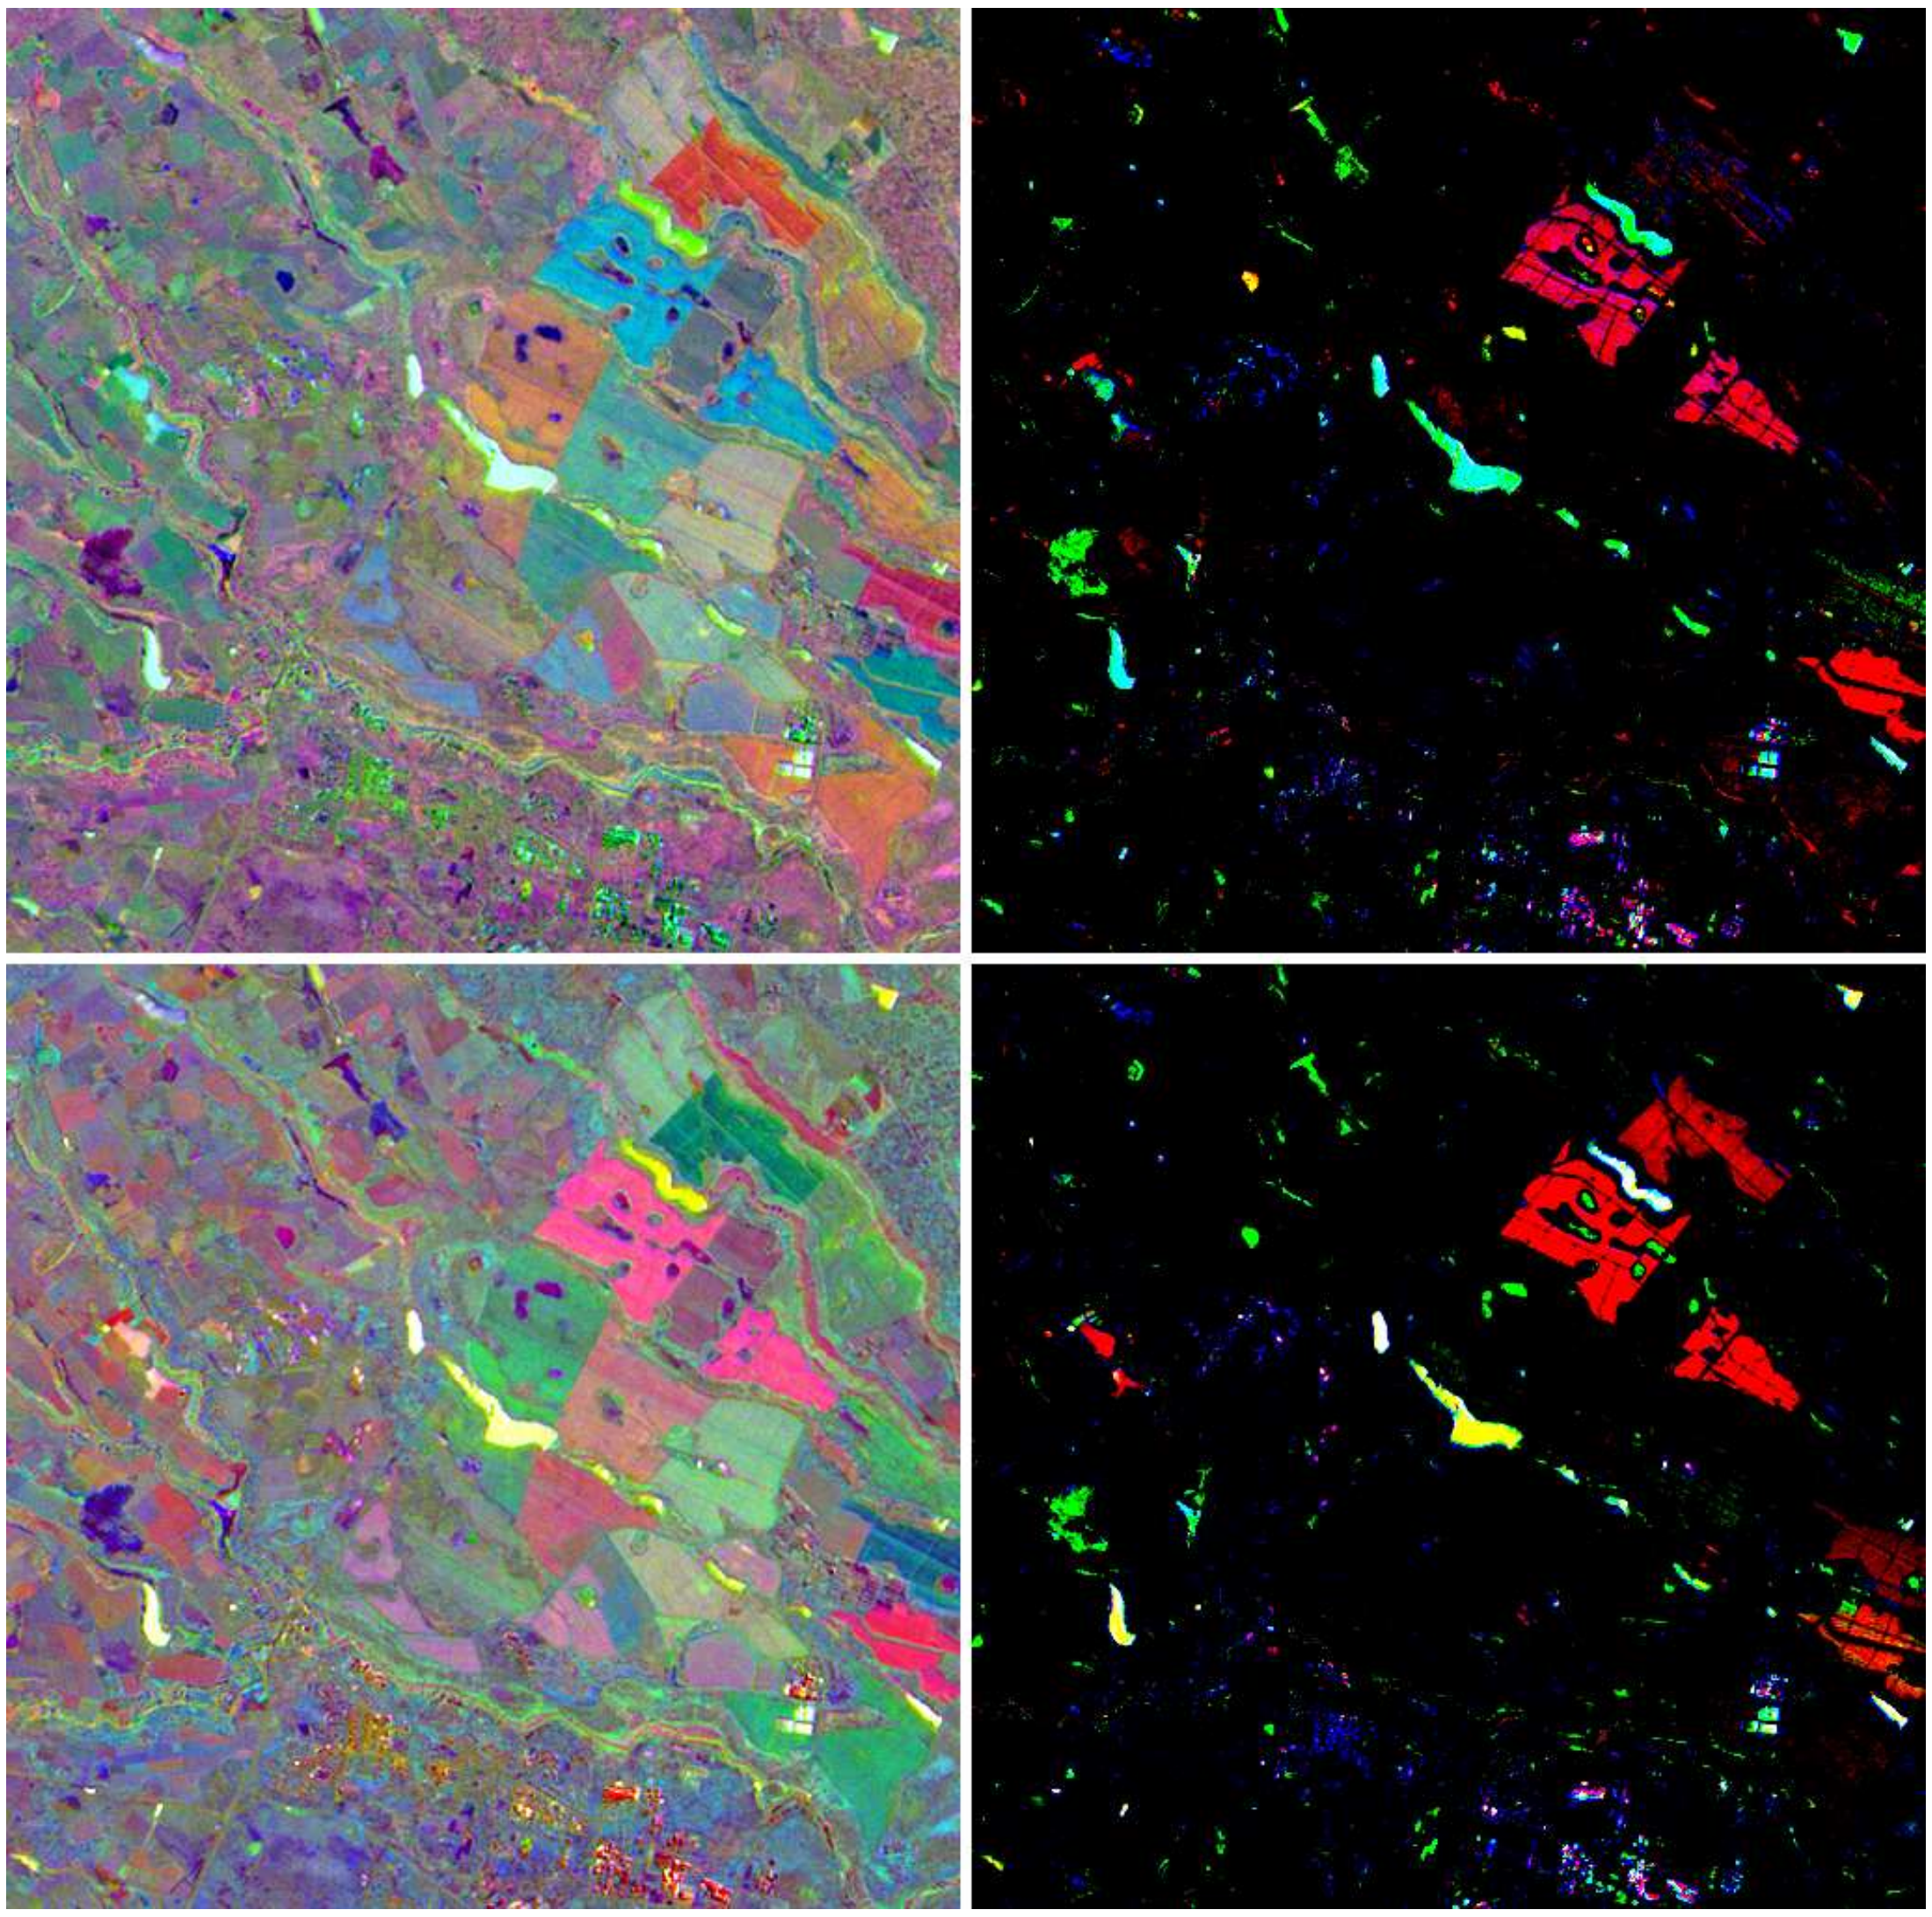

Figure 3: SPOT HRV MAD 1, 2 and 3 as RGB (top-left), SPOT HRV absolute values of MAD1, 2 and 3 as RGB, values below two standard deviations masked (top-right), SPOT HRV MAF 1, 2 and 3 of MADs as RGB (bottom-left), SPOT HRV absolute values of MAF 1, 2 and 3 of MADs as RGB, values below two standard deviations masked (bottom-right)